

**FAX TRANSMISSION**

**ATEC ASSOCIATES, INC.**

5150 East 65th Street / Indianapolis, IN 46220 / (317) 849-4990; Fax #: (317) 849-5260

Total Number of Pages 5 (including cover page)

TO: Ms. Ann Kolata

FAX #: (219) 235-9021

COMPANY: City Of South Bend

FROM: B. Lewis

Phone: (317) 849-4990 X-1752

DATE: 6/1/95

RE: \_\_\_\_\_


COMMENTS:

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

**CONFIDENTIALITY NOTE:**

The documents accompanying this fax transmission may contain information from ATEC Associates, Inc. which is confidential and privileged. The information is intended for the use of the individual or entity to whom it is directed. If you are not the intended recipient, be aware that any disclosure, copying, distribution or use of the contents of the faxed information is prohibited. If you have received this fax in error, please notify us by telephone immediately so that we can arrange for the retrieval of the transmitted documents.


INDOT  
N

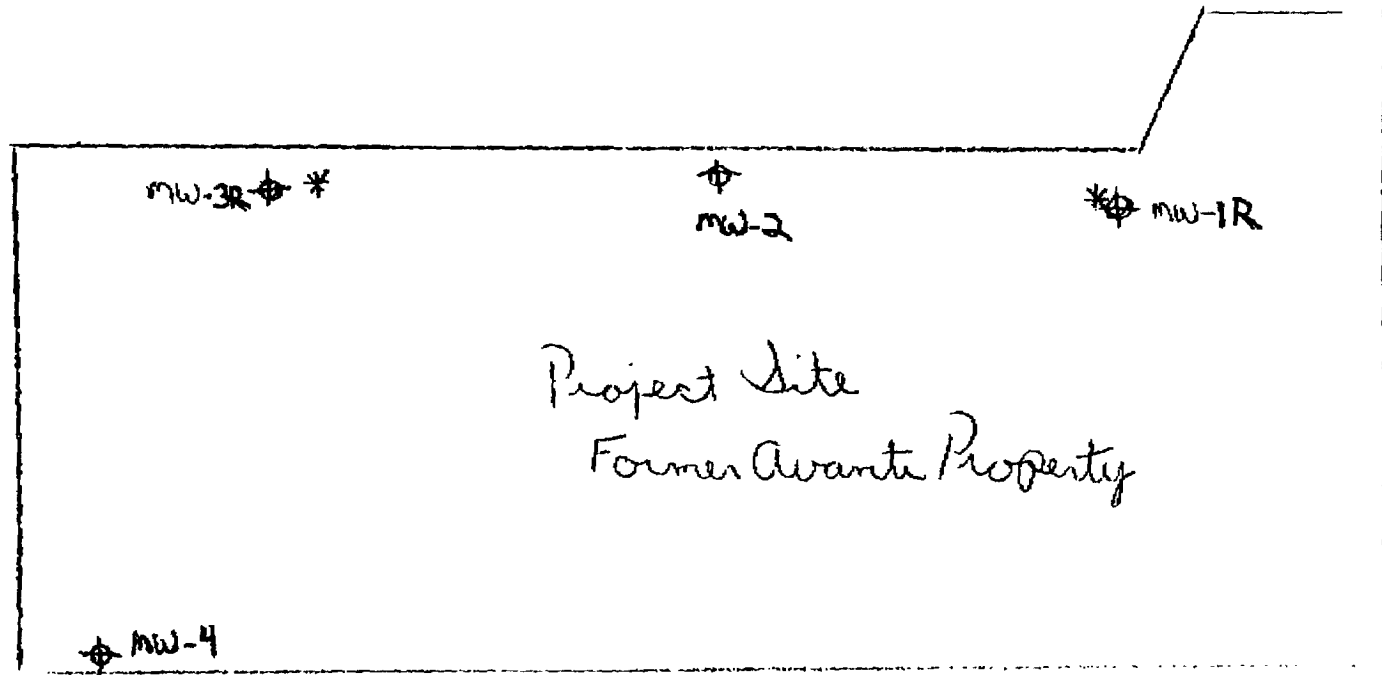

\* Location of missing well  
MW-1R, 3R : Replacement Wells

Scale 1" = 100'

N

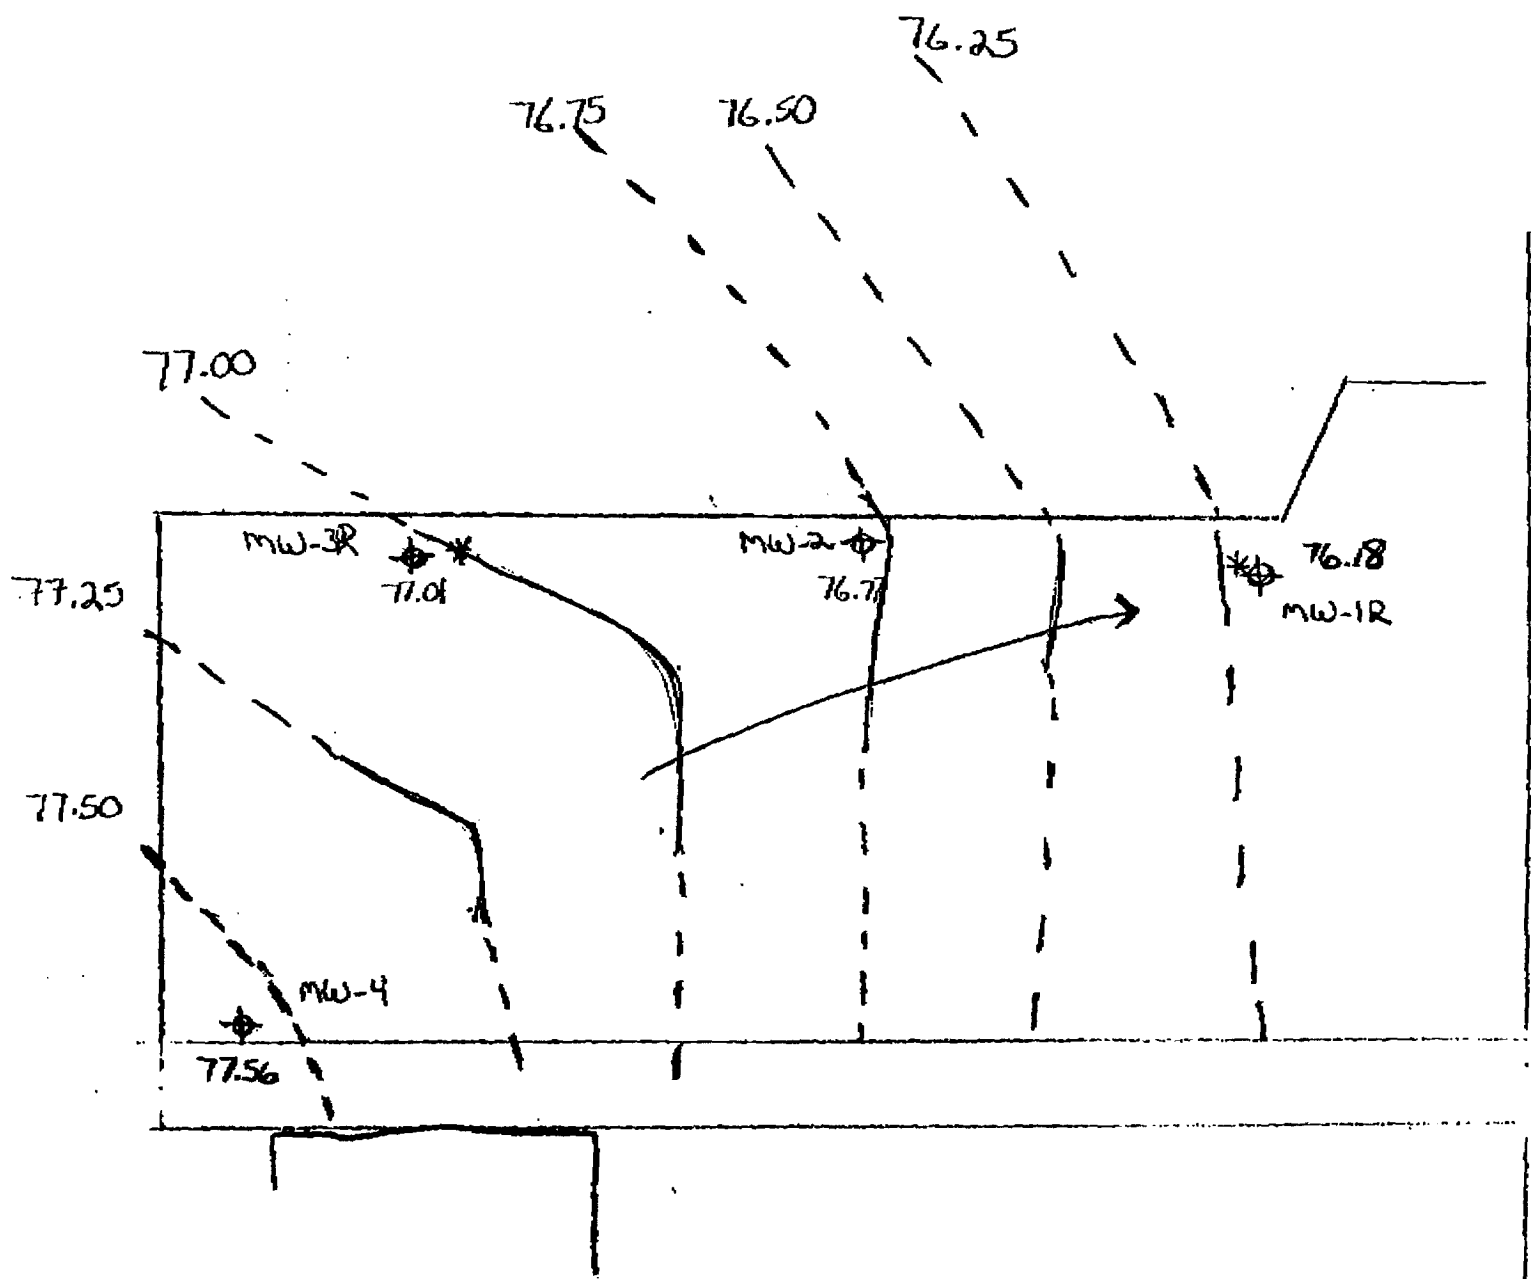

\* Location of missing well

MW-1R + MW-3R : Replacement well

77.56 : Relative groundwater elevations

Scale  
1" = 100'

Received: 05/16/95

SAMPLE ID MW-1R TEST CODE 8240 NAME Volatile  
 FRACTION Q1A Date & Time Collected 05/16/95 Category WATER

DATE ANALYZED	<u>05/17/95</u>
INSTRUMENT	<u>Incos XL</u>
DILUTION FACTOR	<u>1</u>
ANALYST	<u>T. Harrison</u>
VERIFIED BY	<u>B. Keller</u>
UNITS	<u>ug/L</u>
COMMENTS:	
Analytical Method	<u>SW 846 Mtd. 8240A</u>

**PRIORITY POLLUTANTS**  
**VOLATILE COMPOUNDS**

<u>PARAMETER</u>	<u>CAS #</u>	<u>RESULT</u>	<u>LIMIT</u>
Chloromethane	74-87-3	<u>&lt;10</u>	<u>10</u>
Bromomethane	74-83-9	<u>&lt;10</u>	<u>10</u>
Vinyl Chloride	75-01-4	<u>35</u>	<u>10</u>
Chloroethane	75-00-3	<u>&lt;10</u>	<u>10</u>
Methylene Chloride	75-09-2	<u>&lt;5</u>	<u>5</u>
Acetone	67-64-1	<u>&lt;100</u>	<u>100</u>
Carbon Disulfide	75-15-0	<u>&lt;100</u>	<u>100</u>
1,1-Dichloroethene	75-35-4	<u>&lt;5</u>	<u>5</u>
1,1-Dichloroethane	75-34-3	<u>&lt;5</u>	<u>5</u>
Total 1,2-Dichloroethene		<u>14</u>	<u>5</u>
Chloroform	67-66-3	<u>&lt;5</u>	<u>5</u>
1,2-Dichloroethane	107-06-2	<u>&lt;5</u>	<u>5</u>
2-Butanone	78-93-3	<u>&lt;100</u>	<u>100</u>
1,1,1-Trichloroethane	71-55-6	<u>&lt;5</u>	<u>5</u>
Carbon Tetrachloride	56-23-5	<u>&lt;5</u>	<u>5</u>
Vinyl Acetate	108-05-4	<u>&lt;50</u>	<u>50</u>
Bromodichloromethane	75-27-4	<u>&lt;5</u>	<u>5</u>
1,2-Dichloropropane	78-87-5	<u>&lt;5</u>	<u>5</u>
Trans-1, 3-Dichloropropene	10061-02-6	<u>&lt;5</u>	<u>5</u>
Trichloroethene	79-01-6	<u>&lt;5</u>	<u>5</u>

Received: 05/16/95

SAMPLE ID MU-1R TEST CODE 8240 NAME Volatile  
FRACTION 01A Date & Time Collected 05/16/95 Category WATER

Dibromochloromethane	124-48-1	<u>&lt;5</u>	<u>5</u>
1,1,2-Trichloroethane	79-00-5	<u>&lt;5</u>	<u>5</u>
Benzene	71-43-2	<u>&lt;5</u>	<u>5</u>
cis-1, 3-Dichloropropene	10061-01-5	<u>&lt;5</u>	<u>5</u>
2-Chloroethylvinylether	110-75-8	<u>&lt;10</u>	<u>10</u>
Bromoform	75-25-2	<u>&lt;5</u>	<u>5</u>
4-Methyl-2-Pentanone	108-10-1	<u>&lt;50</u>	<u>50</u>
2-Hexanone	591-78-6	<u>&lt;50</u>	<u>50</u>
Tetrachloroethene	127-18-4	<u>6</u>	<u>5</u>
1,1,2,2-Tetrachloroethane	79-34-5	<u>&lt;5</u>	<u>5</u>
Toluene	108-88-3	<u>&lt;5</u>	<u>5</u>
Chlorobenzene	108-90-7	<u>&lt;5</u>	<u>5</u>
Ethylbenzene	100-41-4	<u>&lt;5</u>	<u>5</u>
Styrene	100-42-5	<u>&lt;5</u>	<u>5</u>
Total Xylenes		<u>&lt;5</u>	<u>5</u>
Acrolein	107-02-8	<u>&lt;10</u>	<u>10</u>
Acrylonitrile	107-13-1	<u>&lt;100</u>	<u>100</u>
Iodomethane	74-88-4	<u>&lt;100</u>	<u>100</u>
trans 1,4-Dichloro-2-butene	110-57-6	<u>&lt;100</u>	<u>100</u>
Ethyl methacrylate	97-63-2	<u>&lt;100</u>	<u>100</u>
1,2,3-Trichloropropane	96-18-4	<u>&lt;100</u>	<u>100</u>
Trichlorofluoromethane	75-69-4	<u>&lt;10</u>	<u>10</u>
Dichlorodifluoromethane	75-61-8	<u>&lt;100</u>	<u>100</u>